


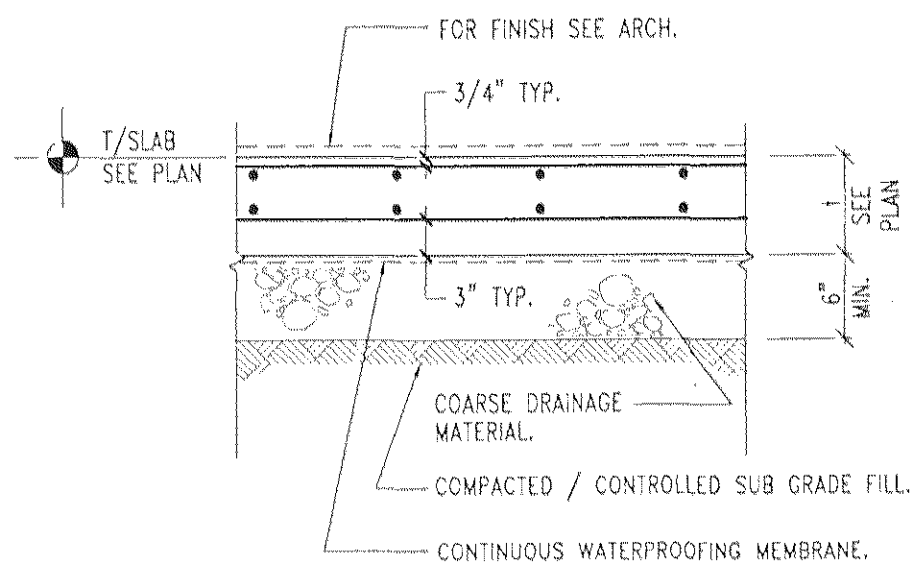


1 TYP. FRAMED SLAB ON GRADE DETAIL

SCALE: N.T.S.

NOTE:

1. SEE GEOTECHNICAL REPORT AND SPECIFICATION ON EARTH WORK FOR DEPTH OF CONTROLLED (ENGINEERED) FILL AND DEWATERING REQUIREMENTS.
2. SEE DWG. 5-9 FOR ADD'L SLAB DETAILS.

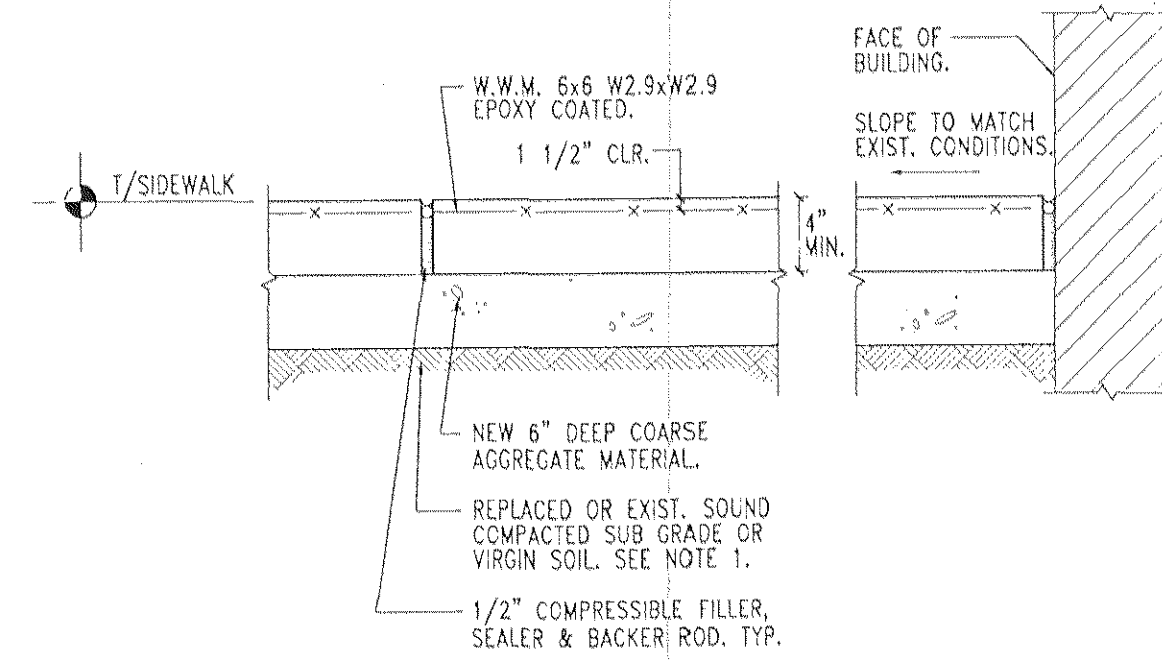

2 TYP. SIDEWALK SLAB ON GRADE DETAIL


SCALE: N.T.S.

NOTES:

1. REMOVE ALL DELETERIOUS AND UNSUITABLE SUBGRADE MATERIAL. REPLACE W/ COMPACTED FILL.
2. CONCRETE SHALL BE PIGMENTED PER DEPARTMENT OF HIGHWAY SPECIFICATIONS TO MATCH EXISTING.
3. ALL FILL SHALL BE COMPACTED IN 6" LIFTS TO AT LEAST 95% OF THE MAXIMUM DRY DENSITY PER PER ASTM D-1557.
4. CONTROL JOINTS SHALL BE 1/4" WIDE BY 1" DEEP LOCATION TO MATCH EXIST. (5'-0" O.C. MAX). PROVIDE EXPANSION JOINTS @ 15'-0" O.C. MAX. FILL JOINTS W/ 1/2" COMPRESSIBLE FILLER, SEALANT AND BACKER ROD.
5. SEE ARCH. FOR EXTENT OF NEW SIDEWALK WORK.


DEMO:

1. REMOVE EXIST. CONCRETE SLAB AND FILL AS REQ'D FOR NEW WORK.

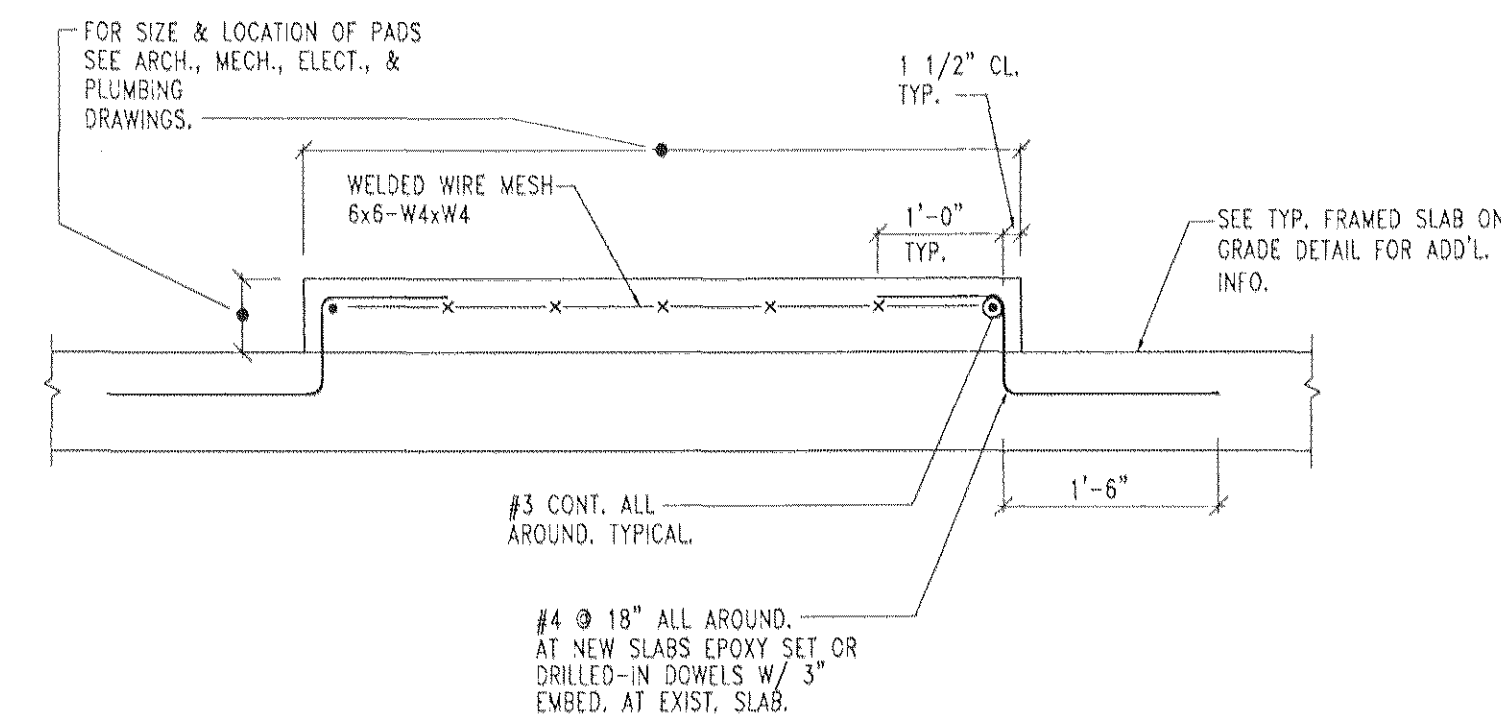

3 TYP. CONCRETE PAD DETAIL

SCALE: N.T.S.

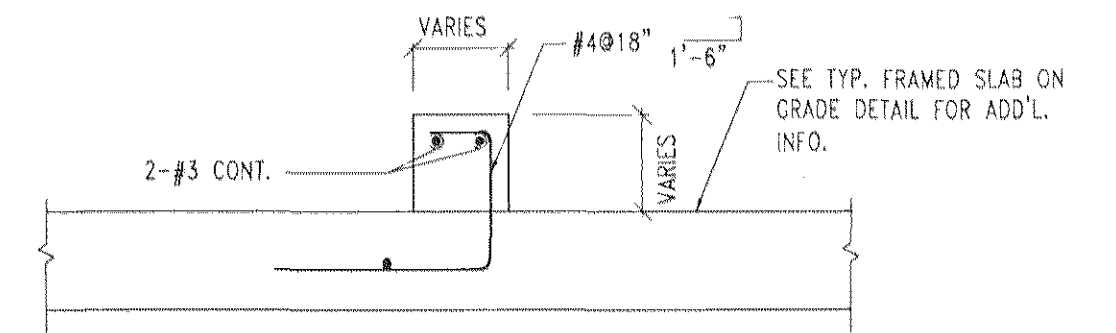


4 TYPICAL CONCRETE CURB DETAIL

SCALE: N.T.S.

NOTE:

1. SEE ARCH., MECH., AND ELECTRICAL DRAWINGS FOR CURB SIZE AND LOCATIONS.

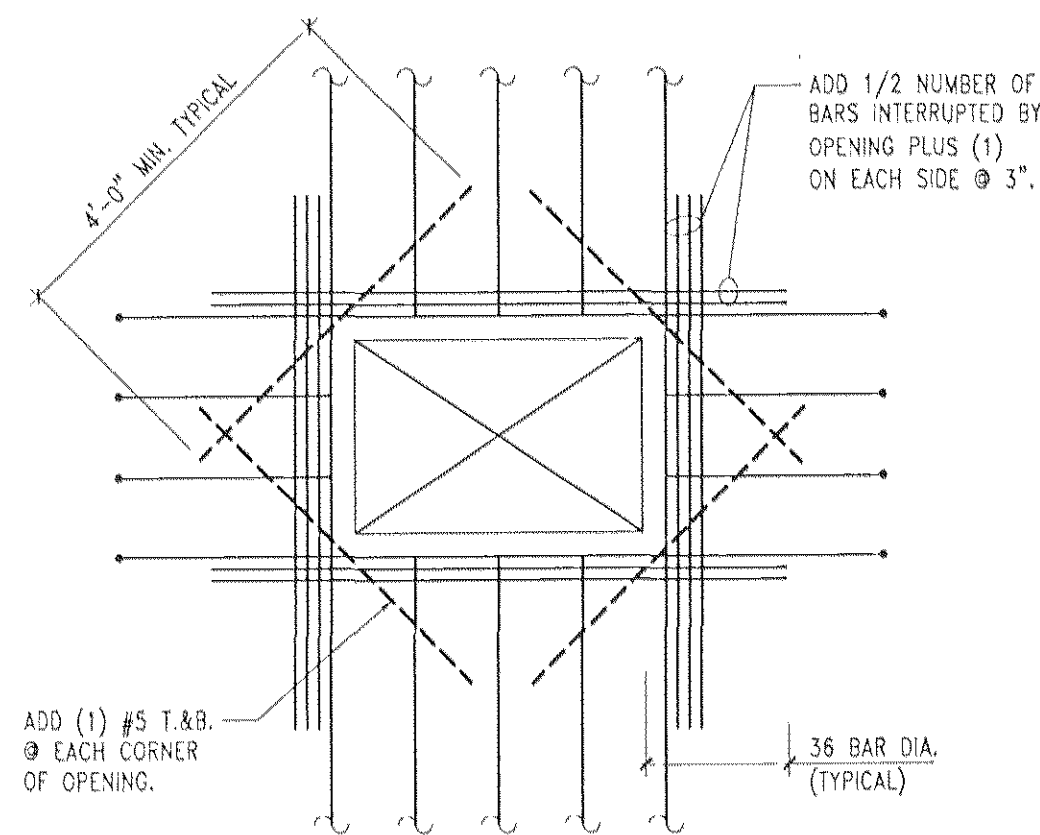


5 TYP. WALL/SLAB OPENING DETAIL

SCALE: N.T.S.


NOTE:

1. COORDINATE OPENING SIZE WITH ARCH., HVAC, ELEC., AND PLUMBING DRAWINGS.
2. FOR OPENINGS NOT SHOWN IN PLAN, MAX. OPENING SIZE TO BE 2'-0" x 2'-0".
3. SEE PLAN FOR ADD'L REINF. AROUND OPENINGS.

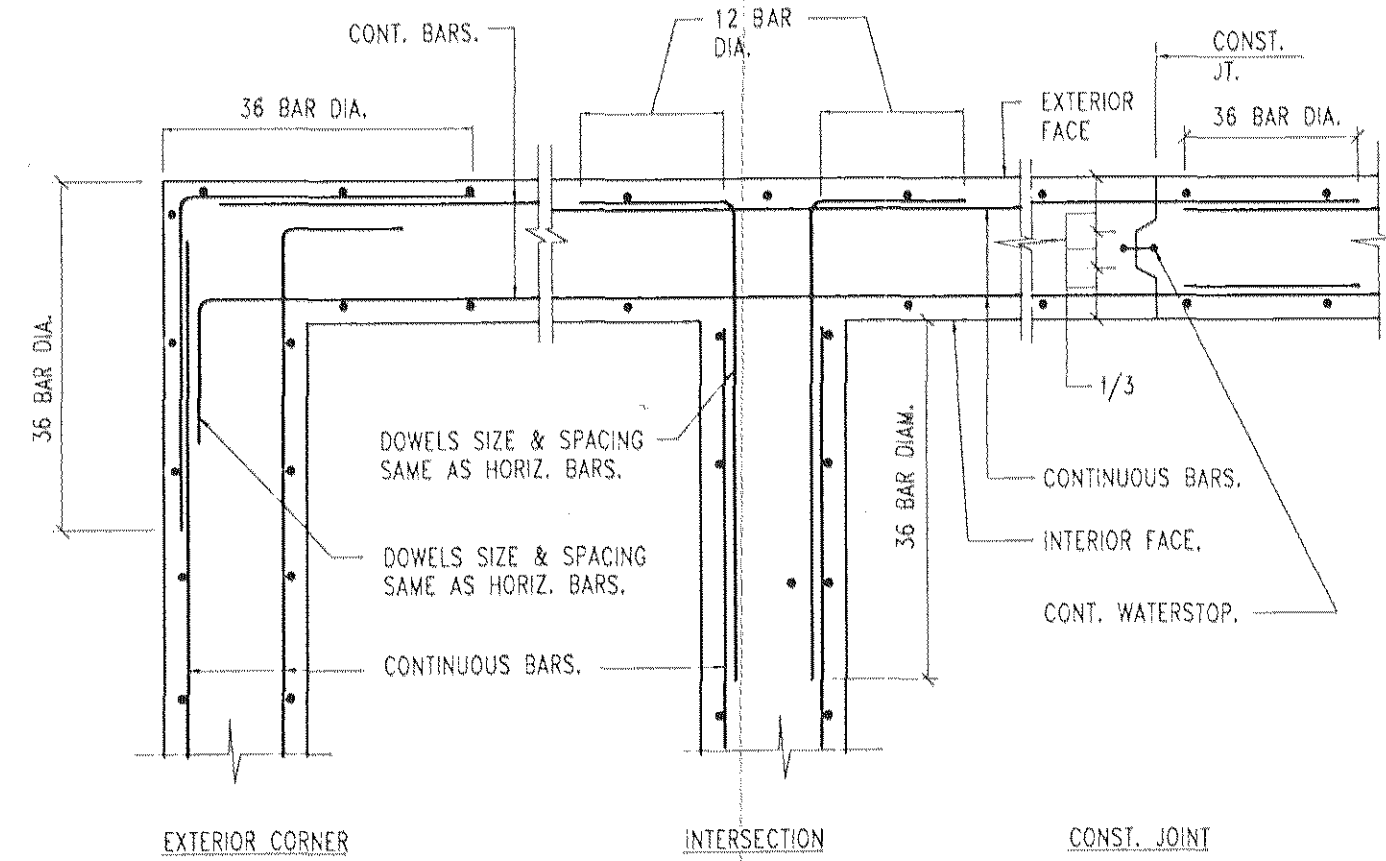

6 TYPICAL DETAIL OF CONTINUOUS BARS IN WALLS AND BEAMS

SCALE: N.T.S.

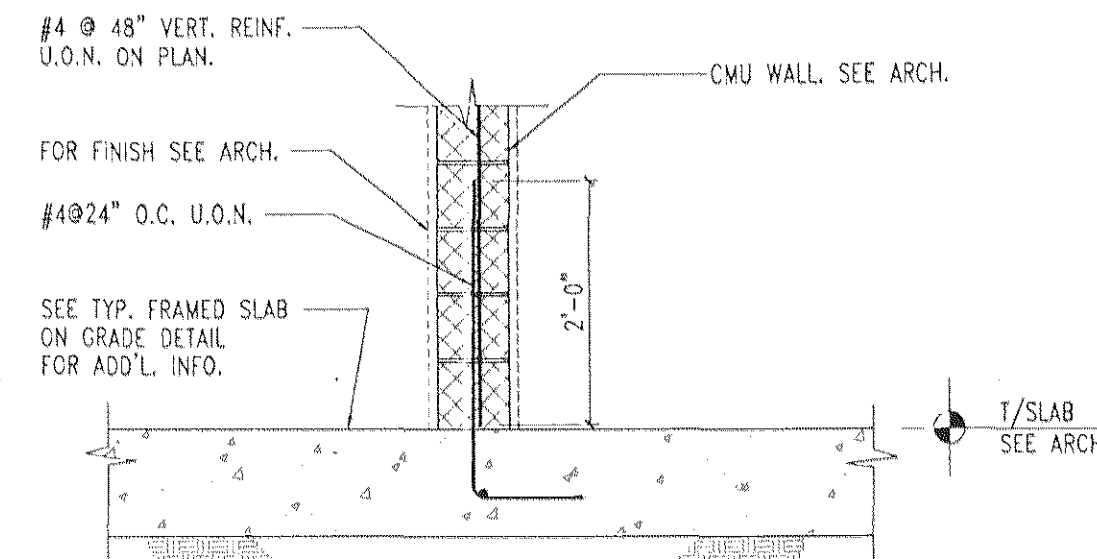


7 TYP. BASE DETAIL AT CMU PARTITIONS OVER FRAMED SLAB ON GRADE

SCALE: N.T.S.


NOTES:

1. FOR LOCATIONS OF CMU PARTITIONS SEE ARCH.

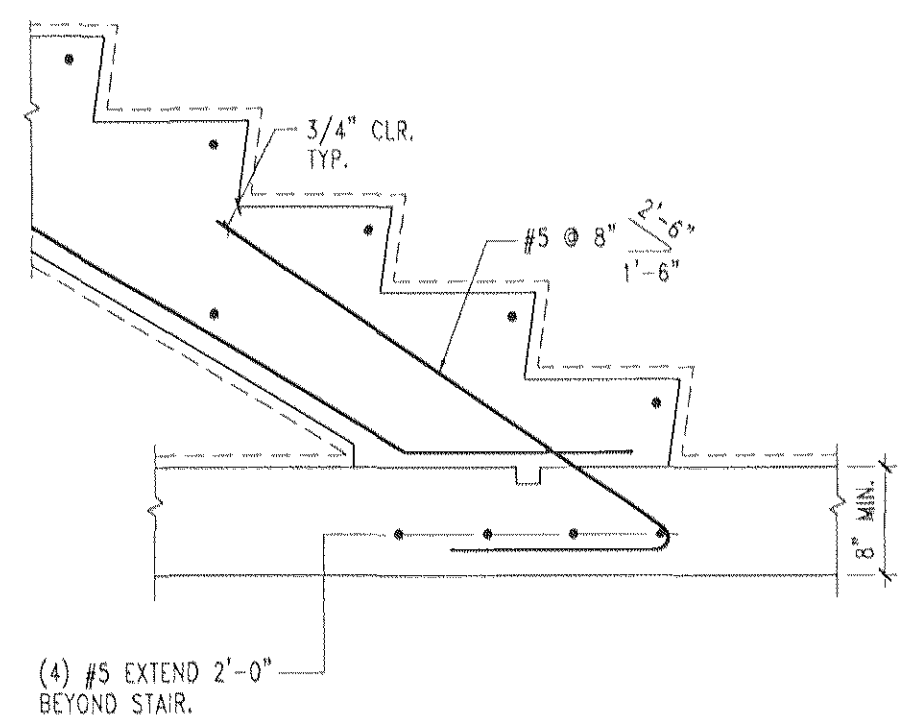

8 TYP. DETAIL AT CONC. STAIR BASE

SCALE: N.T.S.

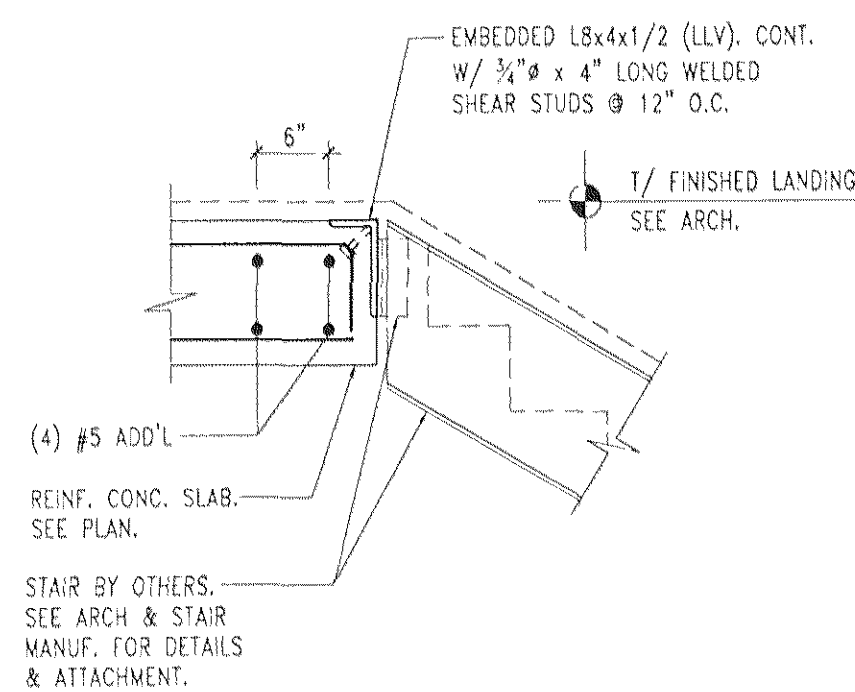


9 TYP. DETAIL AT TOP AND BOT. OF STEEL STAIR

SCALE: N.T.S.

NOTE:

1. PROVIDE S.W. EMBEDDED ANGLE IN SLAB AT BOTTOM OF STAIR.

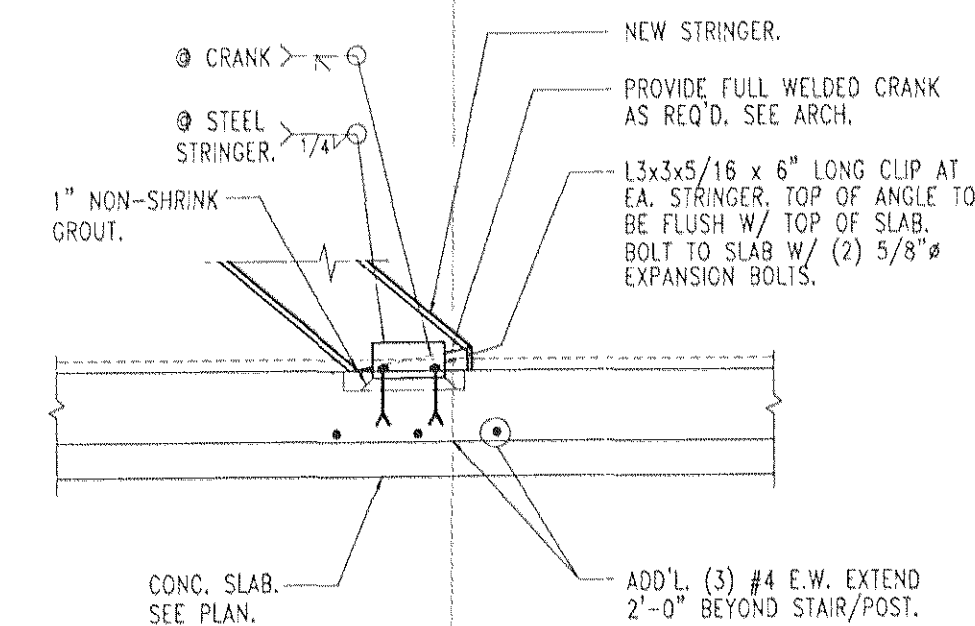


10 TYP. DETAIL AT BASE OF STEEL STAIR STRINGER/POST

SCALE: N.T.S.

NOTES:

1. COORDINATE STAIR / POST LOCATION W/ARCH. AND STAIR MANUFACTURER.

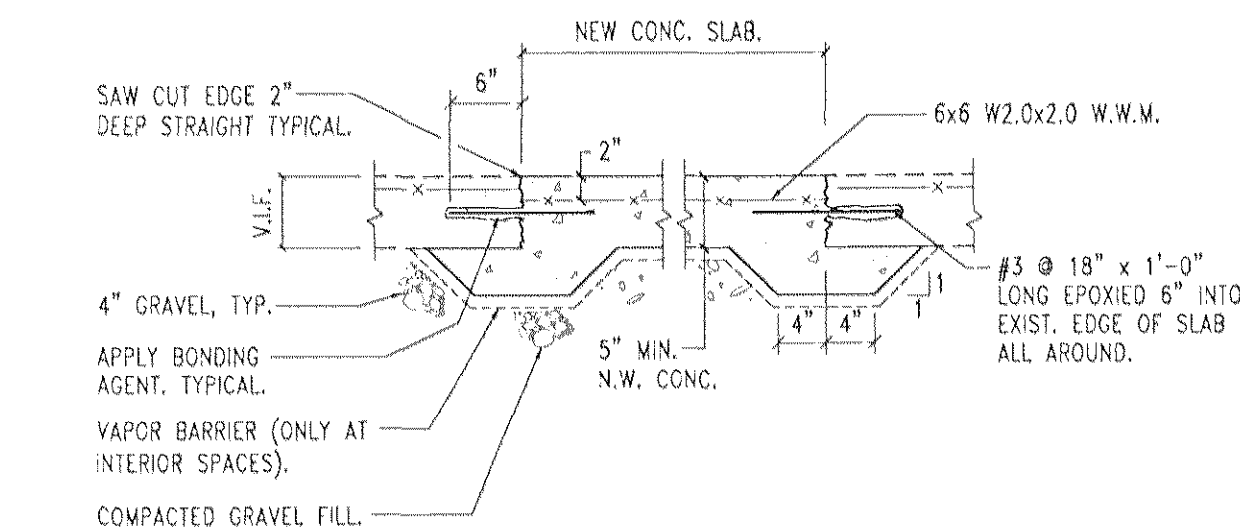

11 TYP. NEW SLAB-ON-GRADE/PATCHING DETAIL

SCALE: N.T.S.

NOTE:

1. DO NOT DISTURB ANY UNDERGROUND PLUMBING LINES, V.I.F.

3	10/13/06	Issued for Construction
2	06/01/06	Issued for BID
1	12/21/05	Issued for DOB
no.	date	revision

HAGE ENGINEERING PC
STRUCTURAL CONSULTANTS
65 Bleeker Street, 11th Floor
New York, New York 10012
tel: 212.358.7778
fax: 212.358.7772

project:

THE DEUCE
534 W42ND ST.
NEW YORK, NY

drawing title:

TYP. CONCRETE
DETAILS

job #:

1681

drawn by:

ABC

checked by:

MH

issue date:

12/21/05

scale:

AS NOTED

drawing #:

S-6